INSTALLATION INSTRUCTION BASICS 100/200 T24-BS1 & T24-BS2

SAFETY INSTRUCTION

IMPORTANT: NEVER attempt any work without shutting off the electricity.

- Always turn off power at fuse box prior to installation to prevent electrical shock.
- Intended for indoor use. Dry and damp locations.
- For installation and serviced by a qualified, licensed electrician.
- Install in accordance with national electric code, and local regulations.
- Consult with local inspector to assure compliance.
- Do not submerge, or install within 5 feet of a swimming pool.
- Do not connect the tape directly to high voltage power
- Do not exceed maximum run recommended for each tape series

CAUTION - TO REDUCE RISK OF FIRE AND ELECTRICAL SHOCK

- Read all instructions before installing.
- Handle product with care.
- Do not conceal or extend exposed conductors through a building wall
- To reduce the risk of fire and burns, do not install this lighting system where the exposed bare conductors can be shorted or contact any conductive
 materials
- To reduce the risk of overheating and potential fire risk, make sure all connections are tight.
- Do not install any fixture assembly closer than 6 in. from any curtain, or similar combustible material.
- Do not modify or disassemble product beyond instructions or warranty will be void.
- Failure to follow safety warnings, and installation instruction will void the warranty

ATTENTION - AFIN DE RÉDUIRE LES RISQUES D'INCENDIE ET DE CHOC ÉLECTRIQUE

- Lire toutes les instructions avant d'installer.
- Manipuler le produit avec soin.
- Ne pas dissimuler et faire passer les conducteurs exposés à travers un mur de bâtiment.
- Afin de réduire les risques d'incendie et de brûlures, ne pas installer ce système d'éclairage là où les conducteurs dénudés peuvent être courtcircuités, ou entrer en contact avec des matériaux conducteurs.
- Afin de réduire le risque de surchauffe et d'incendie potentiel, s'assurer que toutes les connexions sont bien serrées.
- Ne pas installer aucun luminaire à moins de 6 pouces d'un rideau ou d'un matériau combustible similaire.
- Ne pas modifier ou démonter le produit au-delà des instructions sous peine d'annuler la guarantie.
- Ne pas respecter les avertissements de sécurité et des instructions d'installation annulera la garantie.













Do not fold or

twist LED Tape

Avoid contact with sharp objects

Install on stable I clean, dry t

Do not bend the tape light to a diameter less than 4

Do not bend the tape light on a horizontal

Do not cover LED tape light with any


Do not power the LED tape while attached to the spool or tightly coiled

TROUBLESHOOTING

• If LED is damaged due to bending, folding, twisting or any sharp object, that LED section may not light up. Damaged LED section can be removed by cutting and reconnecting using 24VDC Basics Inline Tape to Tape Connector (T24-BS-MM) – Make sure that polarity matches between tapes.

WIRING AND INSTALLATION:

1. Turn Power off at circuit breaker




2. Mount Enclosed 24VDC class 2 output remote power supply at desired location. Measured a distance between power supply to the beginning of the tape run and make sure that it is under 40ft.

The maximum allowance distance of wires between the output of power supply and beginning of tape is 40 ft. The minimum output gauge wire of power supply is 20 AWG.

waclighting.com	Headquarters/Eastern Distribution Center	Central Distribution Center	Western Distribution Center
Phone (800) 526.2588	44 Harbor Park Drive	1600 Distribution Ct	1750 Archibald Ave
Fax (800) 526.2585	Port Washington, NY 11050	Lithia Springs, GA 30122	Ontario, CA 91761

2.1) Power Supply: PS-24DC-U60R-BT & PS-24DC-U96R-BT

To extend the cable length between hard wire power supply or a wiring box to a tape sections, an extension cable (T24-BS-EX2-*) is needed. The extension cable package also provides small screw driver to unscrew the connector.

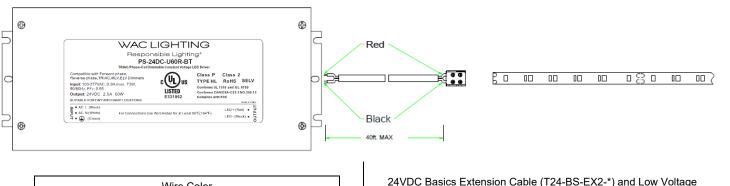


Wire Color				
Power Supply Output	T24-BS-EX2-* Cable	Tape marking		
RED	RED	+24VDC		
BLACK	BLACK	-		

24VDC Basics Extension Cable (T24-BS-EX2-*) and Low Voltage Wiring Box (LED-T-B) can be used to join between wires.



2.2) Power Supply: EN-BT60-24 & EN-BT96-24


This power supply has pre-installed output 6ft lead wire. 24VDC Basics Extension Cable (T24-BS-EX2-*) and Low Voltage Wiring Box (LED-T-B) can be used to join between wires and extend the output lead length.

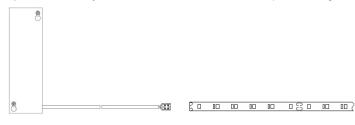


 Measure the desired length of tape light and round it off to the nearest 4-inch interval. Determine necessary quantities of other accessories and power supply need for each run. Do not exceed maximum run recommended for each tape series

80	10	[]		00		ΕC	10	[]	<u> </u>
	3	2	3						

 If necessary, cut tape light to desired length at line indicated with scissors icon. The tape allows for a cut every 4-inch interval.



5. Mount Tape Light: Clean surface before mounting. Peel off 3M adhesive backing cover off as strip is installed, pressing firmly to mounting surface in increments.




 waclighting.com

 Phone (800) 526.2588
 Fax
 (800) 526.2585


Headquarters/Eastern Distribution Center 44 Harbor Park Drive Port Washington, NY 11050 Central Distribution Center 1600 Distribution Ct Lithia Springs, GA 30122 Western Distribution Center 1750 Archibald Ave Ontario, CA 91761 6. Joining between tapes:

Joining tape together (If needed), the following accessories can be used to join between tapes section depending on your application: Basics Tape to Tape Connector (T24-BS-MM) – Making sure that voltage polarity connection is match between tapes.

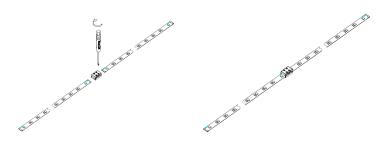


Basics Joiner Cable (T24-BS-IC-*) can be used to join between tape sections – the wire insulation jacket shall be stripped. Make sure that voltage polarity connection matches between tapes.


Wire Color				
Power Supply Output	T24-BS-IC-* Cable	Tape marking		
RED	RED	+24VDC		
BLACK	BLACK	-		



Basics Flex Y Connector (T24-BS-Y) - the wire insulation jacket shall be stripped, Make sure polarity matches between tapes.

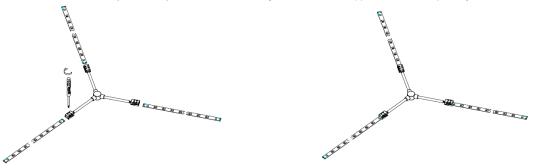

Basics Flex X Connector (T24-BS-X) – the wire insulation jacket shall be stripped, Make sure polarity matches between tapes.






Basics Flex X & Y Connector can be used for power feeding by using low voltage wiring box (LED-T-B). Make sure that polarity is correct.


waclight	ing.com	Headquarters/Eastern Distribution Center	Central Distribution Center	Western Distribution Center
Phone (8	300) 526.2588	44 Harbor Park Drive	1600 Distribution Ct	1750 Archibald Ave
Fax ((800) 526.2585	Port Washington, NY 11050	Lithia Springs, GA 30122	Ontario, CA 91761

WAC Lighting retains the right to modify the design of our products at any time as part of the company's continuous improvement program. August 2020 3.

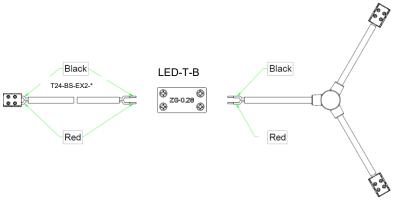

7. Connect electrical power feed wires to Basics Inline Power to Tape Connector (T24-BS-PM) with tape. Make sure that polarity is correct. The wire insulation jacket shall be stripped.


Wire Color				
Power Supply Output	T24-BS-EX2-* Cable	Tape marking		
RED	RED	+24VDC		
BLACK	BLACK	-		

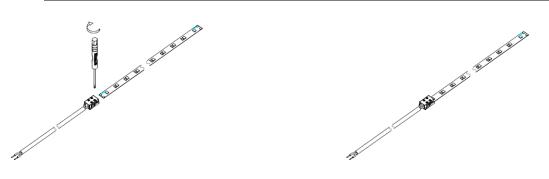

INSTALLATION INSTRUCTION BASICS 100/200 T24-BS1 & T24-BS2


SYSTEM DIAGRAM:

TRIAC / ELV Dimmer Control System: Only PS-24DC-U60R-BT & PS-24DC-U96R-BT

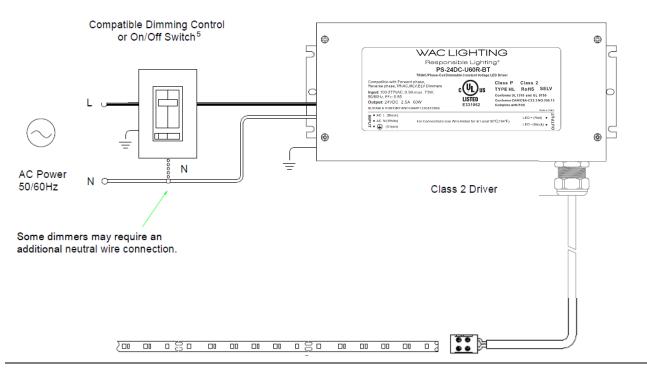

ELV Dimmer Control System

EN-BT60-24 & EN-BT96-24 can only work with ELV dimmer.

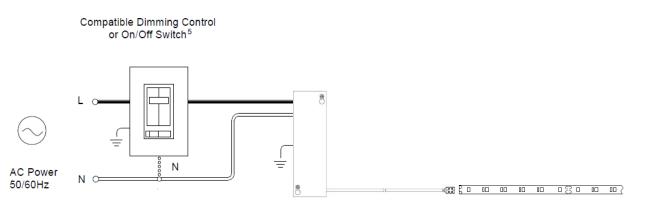

waclighting.com		
Phone	(800) 526.2588	
Fax	(800) 526.2585	